



# FOR 240v PUMP

Line In - L1 & L2

Load L1 to Pump P1

Load L2 to Pump P2

Service Connection rated for:  
 240v 20 amps - one required  
 120v 10 amps - one required.

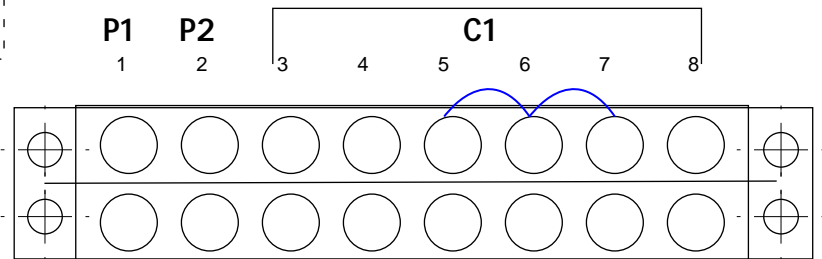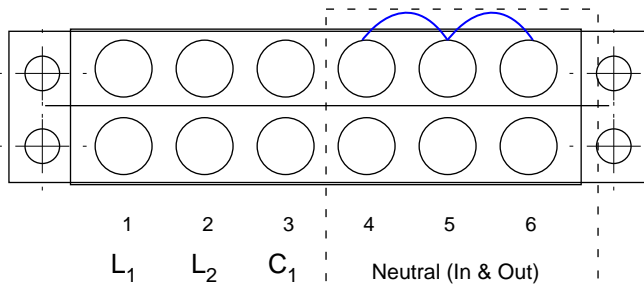

Ground

Dotted Lines Indicate Field Connections

240V  
15 F.L.A. max

Pump



Top Float

Bottom Float

Pump 1

Pump 2

Float (BF)

Float (BF + TF)

Float (TF)

Comp Black

Alarm 1

Alarm 2


to N

Comp

High Level Alarm Float

Comp Air Pressure Sensor

Wide Angle Floats with a Min 4" Tether are Required on Timer Float Switch.

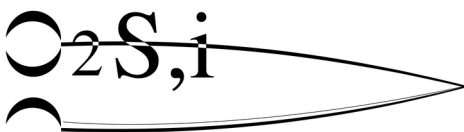

Obsidian Onsite Services, inc.

PO Box 100, Tappahannock, VA 22560  
 804-925-1484 obsidianonsite@verizon.net

Demand Dose Control Panel  
 Model Sim-DD-120/240